


Safety & Security 2012

28.02. - 02.03.2012

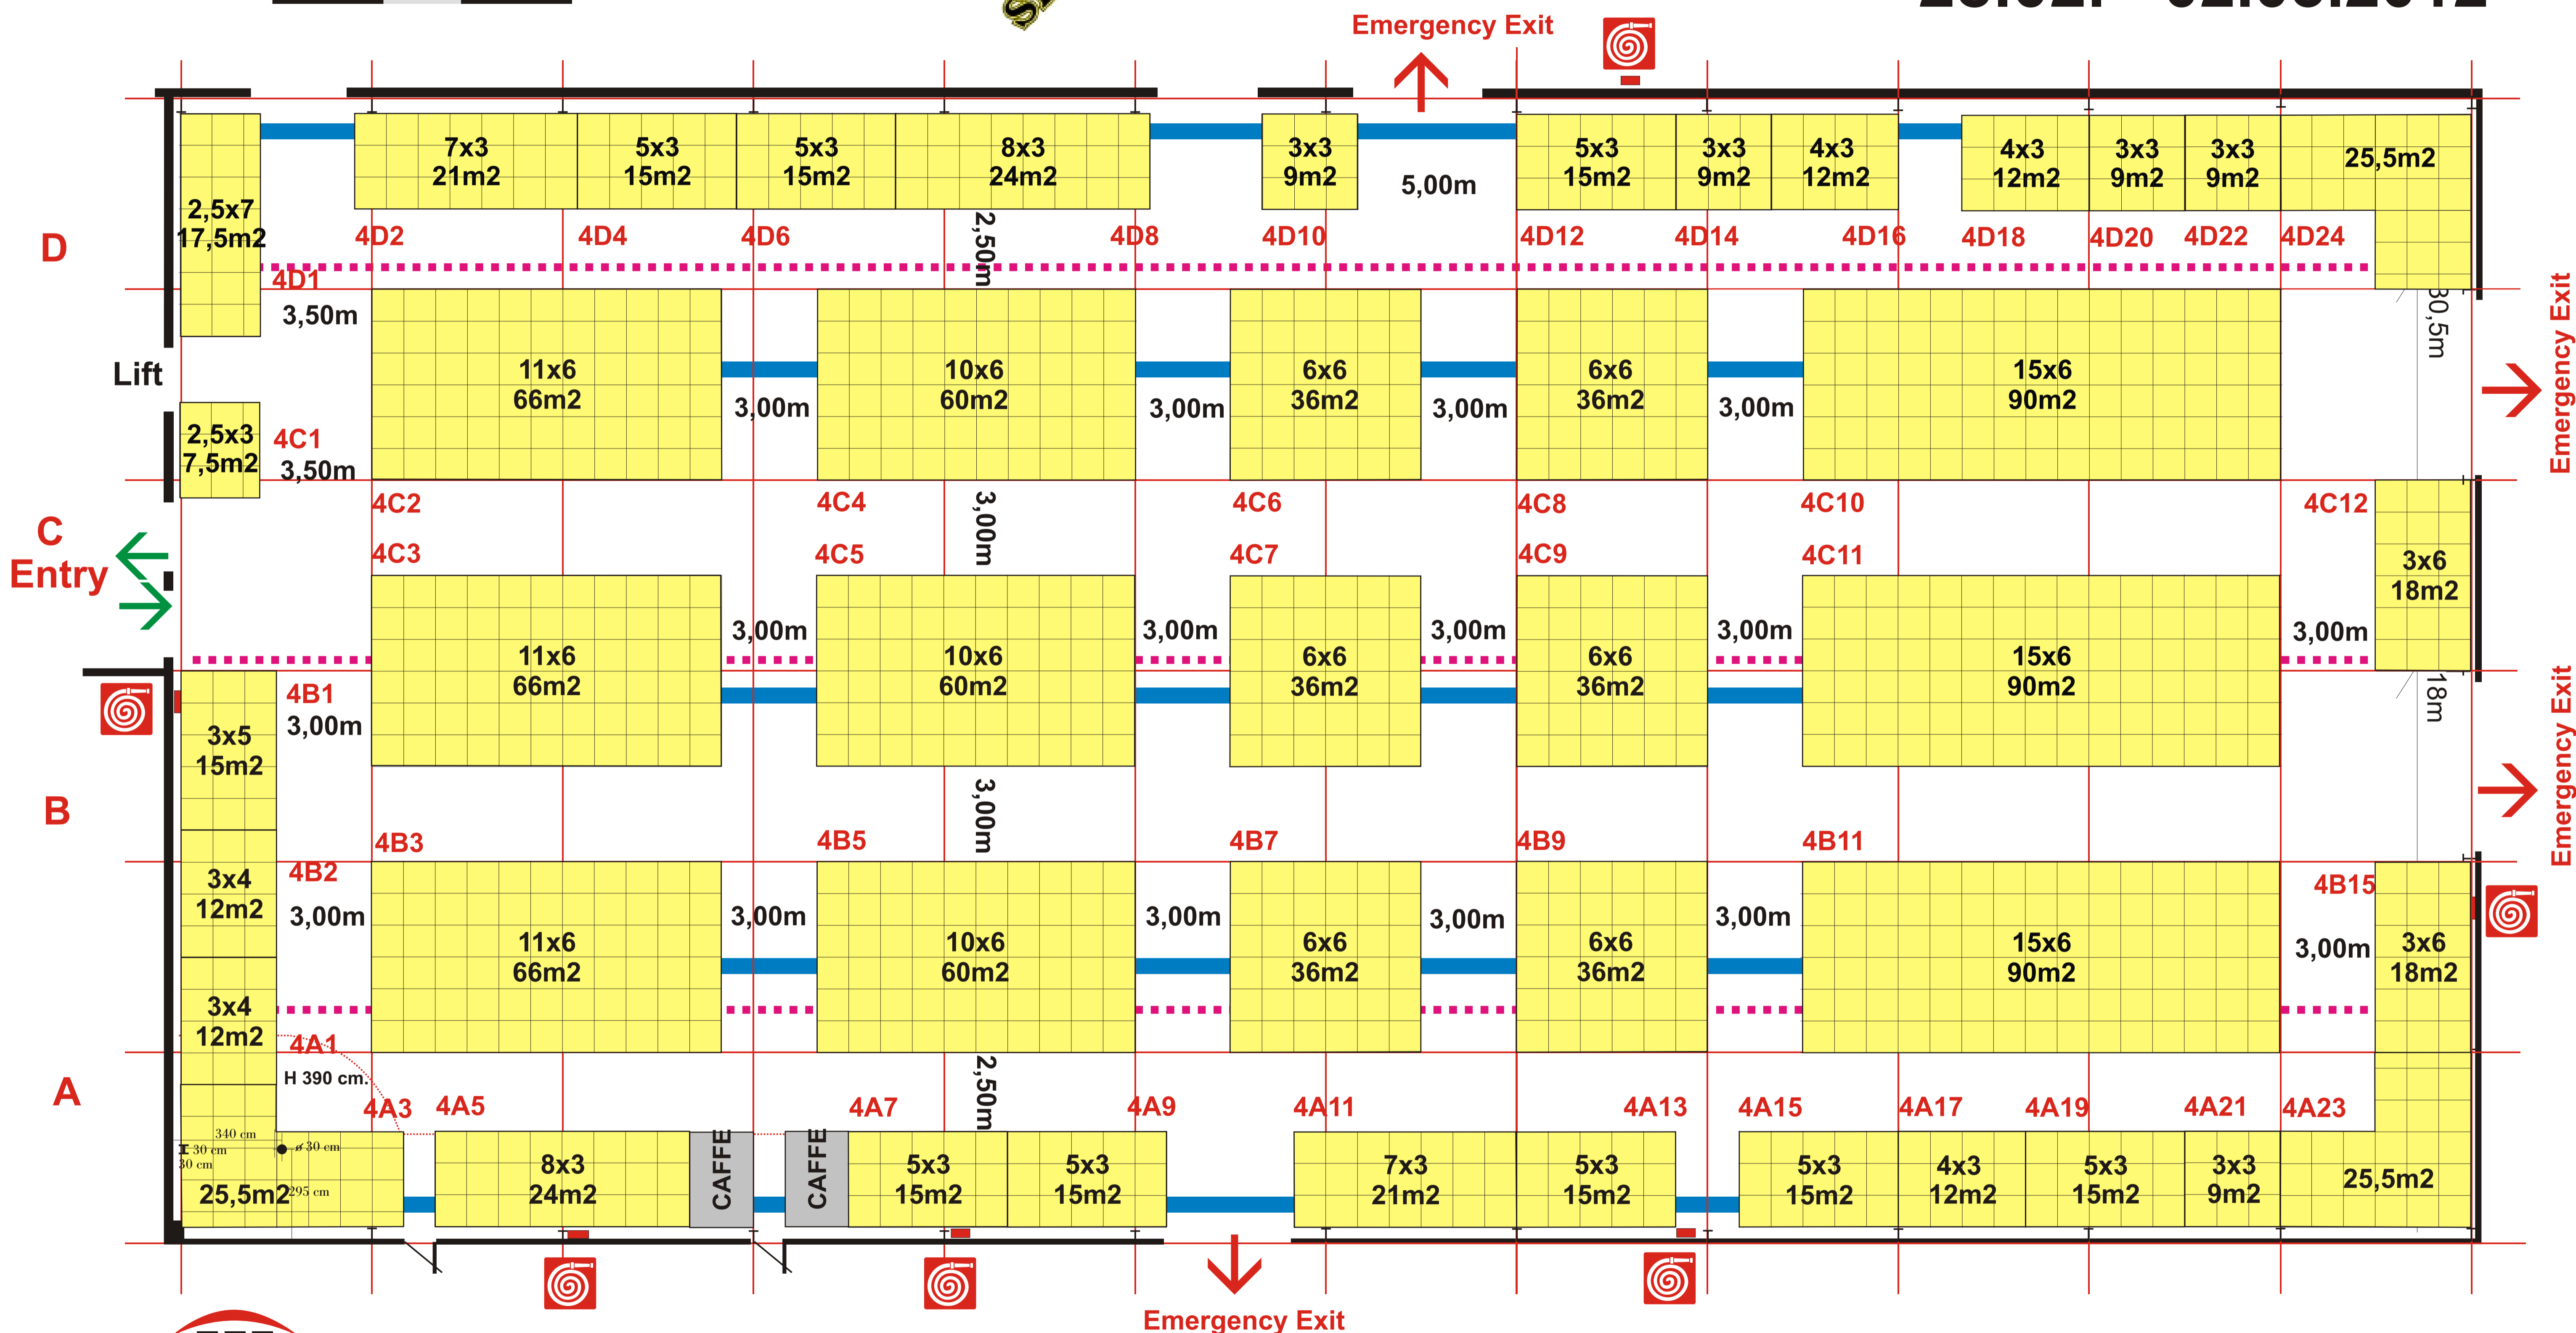

ИНТЕР ЕКСПО ЦЕНТЪР • IEC
preliminary allocation

Hall 4

Attention!
Fire Plug and Emergency Exit
must be free to access

Underground communications:
el. power, water, internet, phones

Fire Sensor - 7m height
Ropes, chains, any auxiliary elements for
suspending of structures, decorations and others
should not cross the sensor beams!